


Chapter 15 COMPREHENSIVE ZONING ORDINANCE

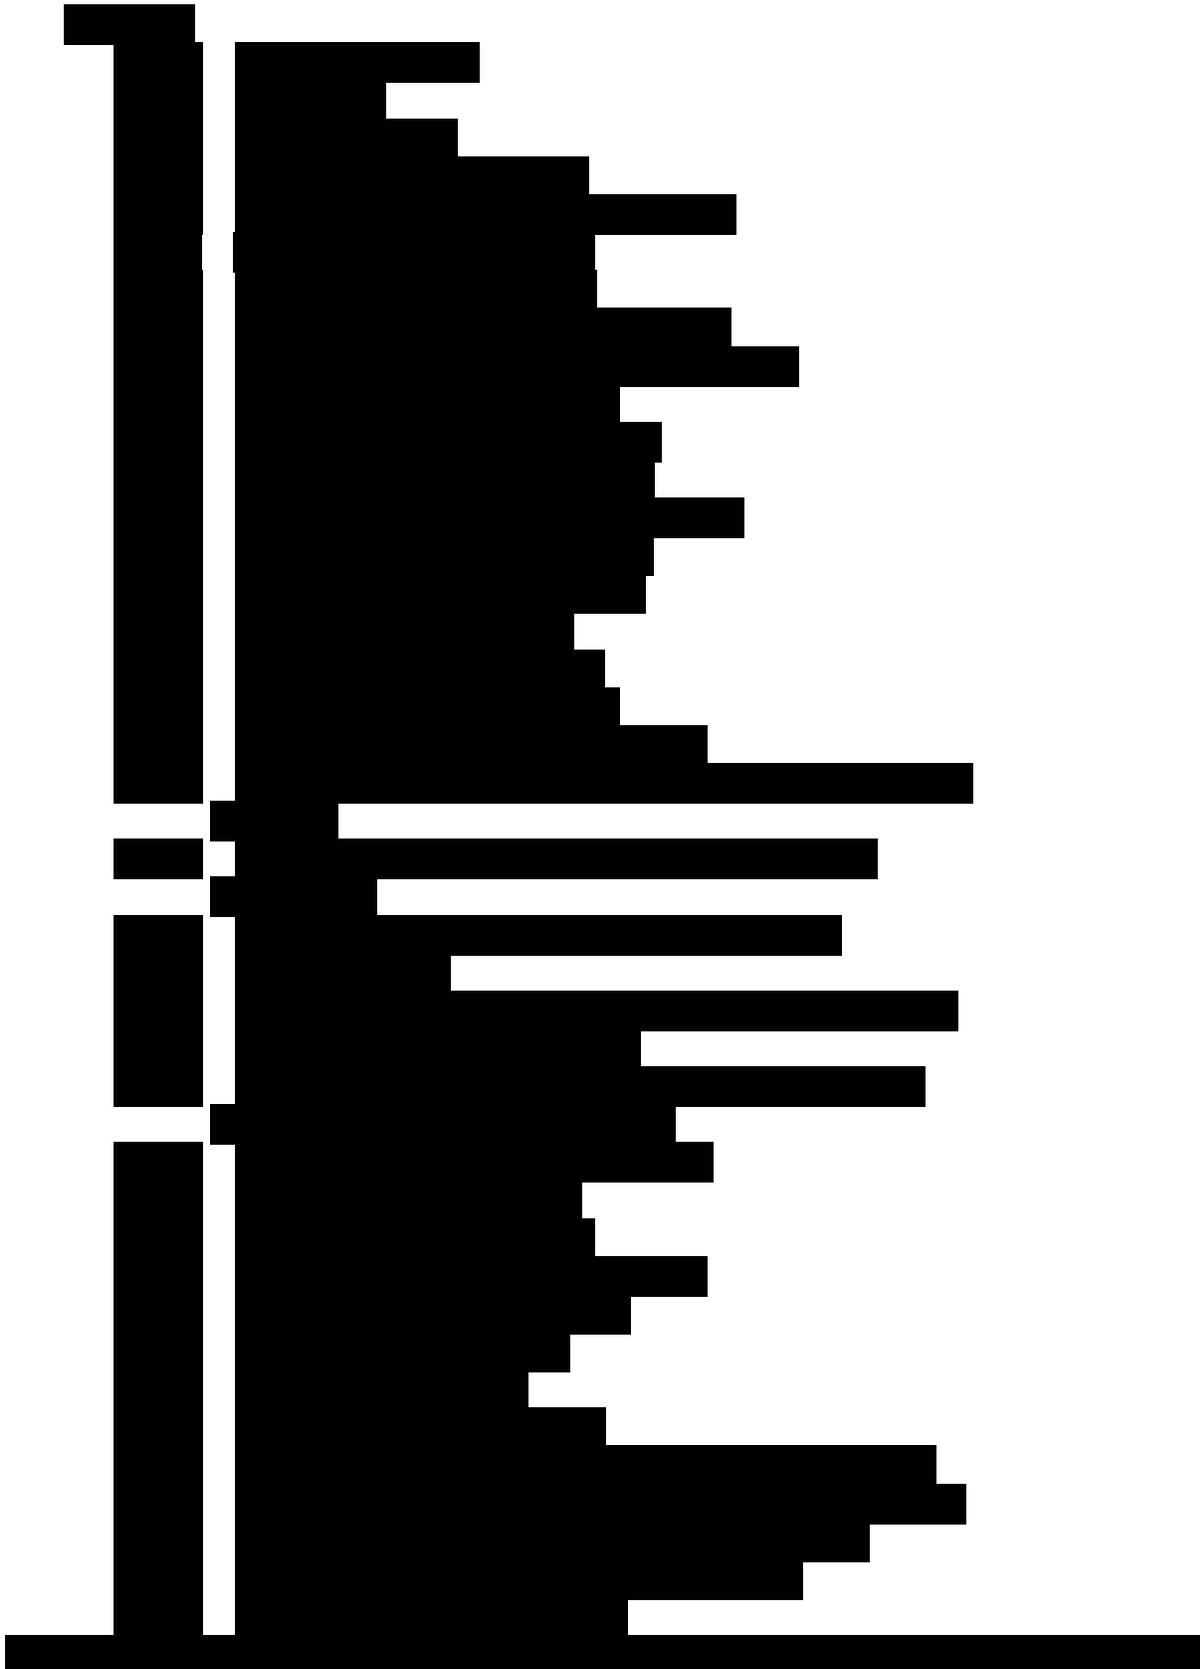

[Redacted text block]

[Redacted text block]

15.710 Standards for Wireless Telecommunication Facilities.

[Redacted text block]

[Redacted]

(aa) Fire Protection. Tower support buildings shall be designed and constructed with built-in ventilation. At least one smoke detector shall be installed in each support or accessory building, which, upon activation, will terminate the electrical power to the building. No combustible storage is permitted in tower support structures. At least a one-hour fire resistant interior surface shall be used in the construction of all buildings at a tower site. Monitored automatic fire extinguishing systems and rapid entry (Knox) systems shall be installed at the discretion of the City's Fire Chief.